



PUDUCHERRY POWER CORPORATION LIMITED
(A GOVERNMENT OF PUDUCHERRY UNDERTAKING)

T.R. PATTINAM - 609606, KARAIKAL.

Phone No: 04368- 233060, 233344

E-Mail : ppclmmc@gmail.com

Fax: 04368 - 233355.

Ref. No: T-188/MMC/2019-20/2812

Dt. 23.03.2020

Our GSTIN No.: 34AAACP6507E1ZS

ENQUIRY

To

Sub: Inviting offer for the supply of Metallic Expansion Joint for HRSG - Reg.

QUOTATION TO BE:

Submitted on or before 13.04.2020 - 12.00 Noon	Opened on 15.04.2020 - 03.00 P.M.
Kept valid for 3 months from the date of opening	Submitted in ONE part

Wax sealed quotations are invited for the supply of Metallic Expansion Joint for HRSG as per the specification enclosed in the annexure and as per the terms and conditions mentioned therein.

Terms and conditions:

1. The rate quoted should be firm and inclusive of all taxes and other charges as admissible.
2. Applicable taxes, freight, packing & forwarding charges and other charges should be clearly mentioned as whether inclusive or extra. If not mentioned, it will be presumed that the rate quoted is inclusive of all taxes and other charges.
3. The rate should be quoted for the specified original make only.
4. The material should be directly supplied to the PPCL site, T.R.Pattinam, Karaikal - 609 606, **on door delivery basis.**
5. The delivery period and mode of despatch should be clearly specified.
6. Validity: Your offer should be valid for **90 days** from the date of receipt of your quotation.
7. 100% payment will be made within 30 days from the date of receipt of your invoice after receipt of material in good condition and acceptance. **The bill in triplicate along with advance stamped receipt should be sent to the undersigned for effecting payment.**



PUDUCHERRY POWER CORPORATION LIMITED
(A GOVERNMENT OF PUDUCHERRY UNDERTAKING)

T.R. PATTINAM - 609606, KARAIKAL.

Phone No: 04368- 233060, 233344

E-Mail : ppclmmc@gmail.com

Fax: 04368 - 233355.


Ref. No: T-188/MMC/2019-20/28/2

Dt. 23.03.2020

Our GSTIN No.: 34AAACP6507E1ZS

PAGE NO.2

8. The L1 position shall be arrived for the total amount quoted basis for both items. The bidders are requested to quote for both items.
9. No payment will be made against document through bank. Part payment will not be accepted for the supply of ordered items.
10. Our GSTIN No.: 34AAACP6507E1ZS as registered with Commercial Taxes Department, Puducherry.
11. Any losses are damage during transit to site should be made good by the supplier at free of cost provided the same is reported within 15 days of the arrival of material at site.
12. Wax sealed quotations should be super scribed as **"QUOTATION/ENQUIRY NO. T - 188 for the supply of Metallic Expansion Joint for HRSG "due on 13.04.2020"**.
13. If the tender opening date happens to be a holiday, the tender will be opened on the next working day.
14. The undersigned reserves all rights to accept/reject any or all the quotations without assigning any reasons thereof.


23/03/2020

EXECUTIVE ENGINEER (MECH)-PLANT



PUDUCHERRY POWER CORPORATION LIMITED
(A GOVERNMENT OF PUDUCHERRY UNDERTAKING)

T.R. PATTINAM - 609606, KARAIKAL.



Phone No: 04368- 233060, 233344

E-Mail : ppclmmc@gmail.com

Fax: 04368 - 233355.

Ref. No: T-188/MMC/2019-20/2812

Dt. 23.03.2020

Our GSTIN No.: 34AAACP6507E1ZS

ANNEXURE

Sl. No	Item Description	Req. Qty.	Unit Rate in Rs	Total Amount in Rs `
1	Metallic Expansion Joint for Economizer Vent (Specification and MOC as per the drawing enclosed)	6 Nos.		
2	Metallic Expansion Bellow for Superheater (Specification and MOC as per the drawing enclosed)	4 Nos.		
	Sub Total			
	Add: P@F Charges			
	Add: Freight Charges			
	Add: GST@18%			
Total amount				
Rupees in words (

Commercial Terms and Conditions:

Sl.No	Details	Terms in Tender	Terms Accepted by the party
1	Price Quoted	F.O.R. PPCL. Site	
2	Payment Terms	Within 30 days after delivery of the materials	
3	Validity	90 Days from date of opening of Tender	
4	Delivery Period	Vendor to specify	
5	Acceptance of All the Terms and Conditions of the Enquiry	To be Accepted	

Signature with Seal of the Party

DESIGN SPECIFICATION

DESIGN PRESSURE : 2 Kg/cm²
 DESIGN TEMPERATURE : 540°C
 DESIGN MOVEMENTS


AXIAL MOVEMENT : ± 30mm
 AXIAL SPRING RATE : 8.66 Kg/mm

INSPECTION & TESTING

1. DIMENSIONAL & VISUAL CHECK
2. 100% D.P TEST ON WELD JOINTS WHEREVER APPLICABLE
3. PNEUMATIC PRESSURE TEST AT 2.1 Kg/cm² FOR 10 MINUTES DURATION AT AMBIENT TEMP.

NOTE :

1. SUITABLE SHIPPING BRACKETS (PAINTED IN YELLOW) WILL BE PROVIDED, TO BE REMOVED AFTER INSTALLATION AT SITE.

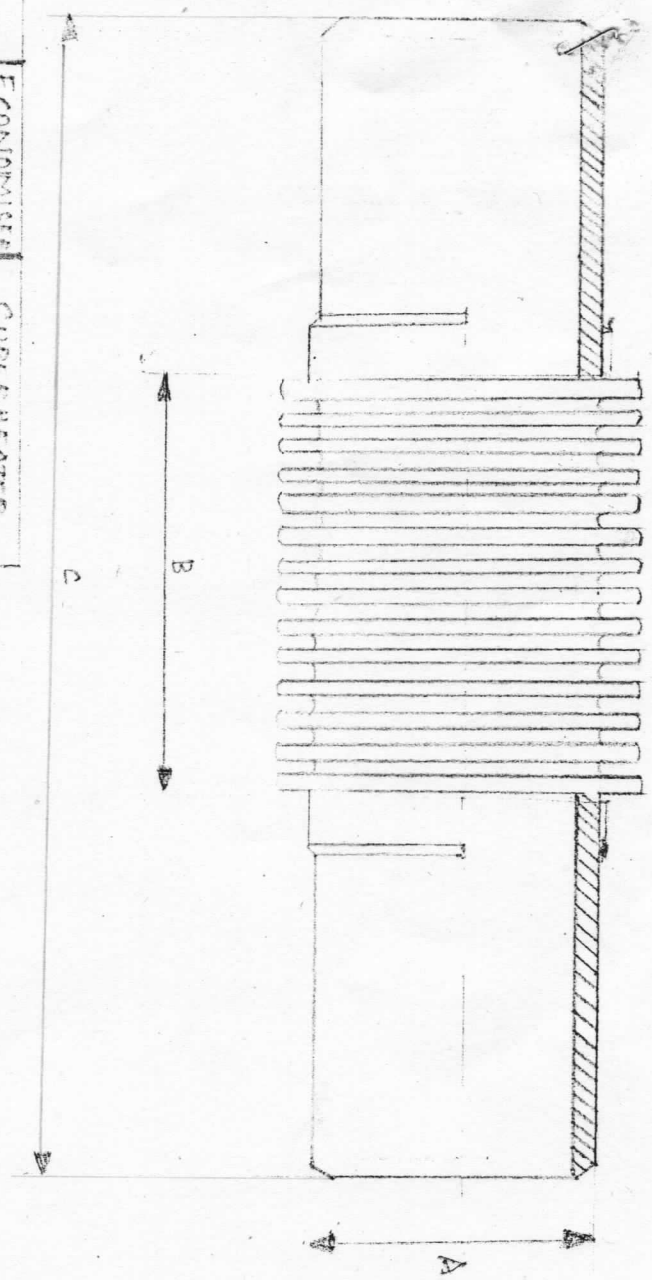

	ECONOMISER	SUPHEATER
A	73 mm	73 mm
B	126 mm	290 mm
C	240 mm	450 mm
Qty	6	4

Sl. No.	DESCRIPTION	MATERIAL OF CONSTRUCTION
1	BELLOWS	A 240 TYP 321
2	END PIPE - SCH 40 (5.16 THK)	A 106 G.R. B

HRS 67 EXPANSION JOINT

PUDUCHERRY POWER CORPORATION LTD

D. N. S. 25/10/2019